
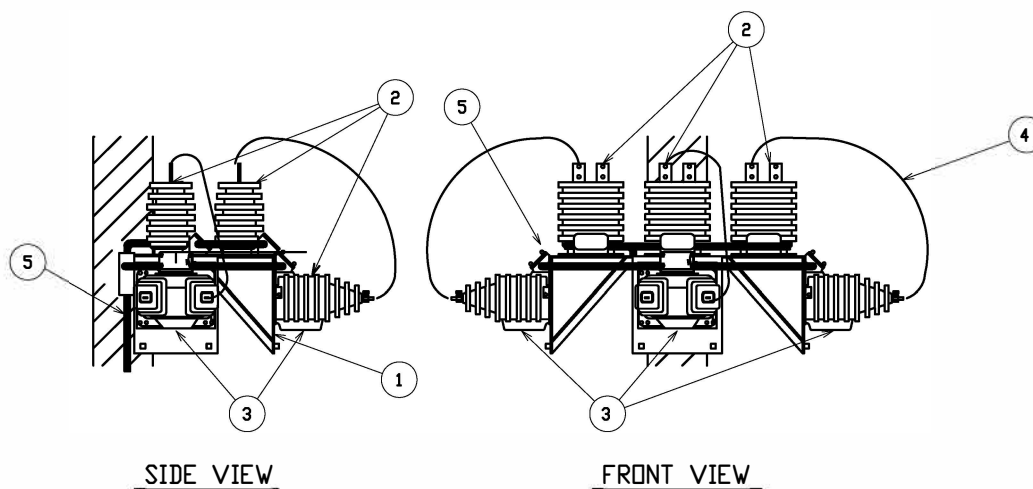
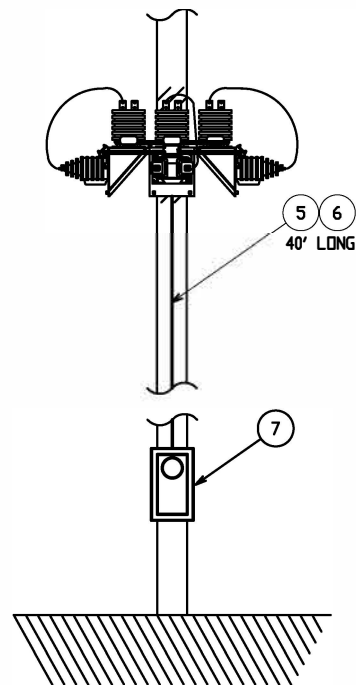


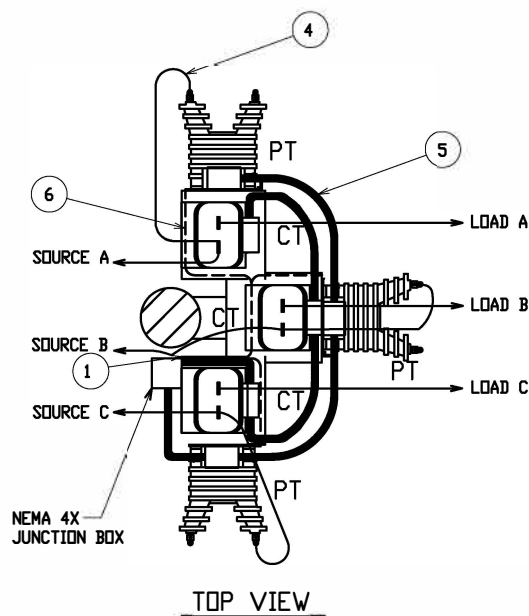

MATERIAL LIST - STANDARD UNIT

ITEM	DESCRIPTION
1	ALUMINUM POLE MOUNT ASSEMBLY
2	CURRENT TRANSFORMER - OUTDOOR TYPE - 15KV - 110KV BIL 50:5 RATIO RF3 - GE JCK-5 #755X052007
3	POTENTIAL TRANSFORMER - OUTDOOR TYPE - 15KV - 110KV BIL - DUAL BUSHING - 8400/14550Y - 70:1 RATIO - GE JVW-5 #765X030044
4	#2 STRANDED INSULATED COPPER TAP WIRE - NON SHIELDED
5	3/4" LIQUID TIGHT FLEX CONDUIT & CONNECTORS WITH SECONDARY WIRING FROM CT'S & PT'S TO 10-POLE TEST SWITCH AND 13 JAW FORM 9S METER BASE 40' LENGTH FROM JUNCTION BOX TO METER BASE
6	GROUNDING OF ALL TRANSFORMER BASES & MOUNTING ASSEMBLY - #6 STRANDED INSULATED COPPER WIRE 40' LONG
7	METER BASE WITH 10-POLE TEST SWITCH - FORM 9S

CATALOG NO: PMC-4532-15

PRIMARY METERING - POLE MOUNTED

15KV

110KV BIL

THREE PHASE WYE CONNECTED (3) OUTDOOR CT (3) OUTDOOR PT



POWER DESIGN INC.
ODELL, OREGON

DRAWN:
JAB

PAGE
1 OF 2

DATE
6-22-20

DRAWING NO.
4532-R1

FILE REF: